


**GRADATION ANALYSIS TEST REPORT**

Product: 10/20mm Single Size  
 Material Code: 1020  
 Supplied by: Breedon Quarry  
 Customer:  
 Site Address:  
 Material type: 13043 12620 / Limestone



Sampled to: BS EN 932- 1: 1997  
 Prepared to: BS EN 932- 2: 1999  
 Test method: BS EN 933- 1: 2012

Sample number	1134
Ticket No	
Sampled by	Healey
Date Sampled	01/04/2019
Sample location	Stockpile
Weather Conditions	

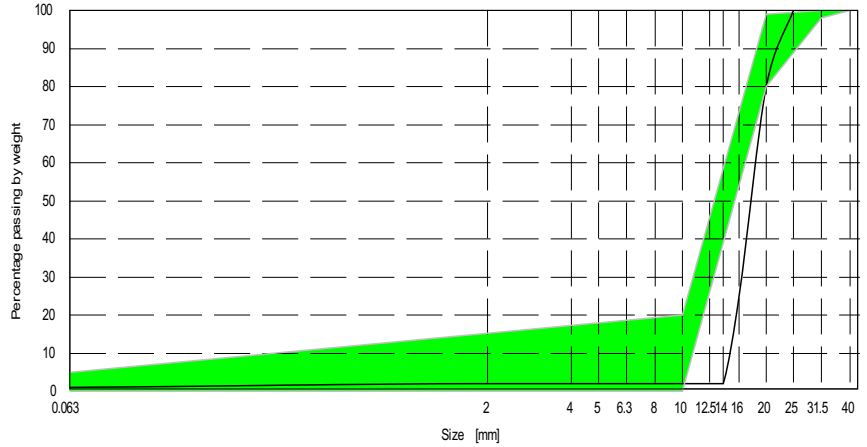

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
40	100	100	Yes	-	-
31.5	100	98 - 100	Yes	-	-
25	100	-	-	-	-
20	80	80 - 99	Yes	-	-
16	25	-	-	-	-
14	2	-	-	-	-
12.5	2	-	-	-	-
10	2	0 - 20	Yes	-	-
8	2	-	-	-	-
6.3	2	-	-	-	-
5	2	-	-	-	-
4	2	-	-	-	-
2	2	-	-	-	-
0.063	0.9	0 - 5.0	Yes	-	-
Moisture content (%)	0.1				
Uniformity Coefficient	1				

Sampled By: Healey

Tested By: Smith

Date Tested: 01/04/2019