


GRADATION ANALYSIS TEST REPORT

Product: 10/20mm Single Size
 Material Code: 1020
 Supplied by: Holme Hall Quarry
 Customer:
 Site Address:
 Material type: BS EN 12620 / Limestone



Sampled to: BS EN 932- 1: 1997
 Prepared to: BS EN 932- 2: 1999
 Test method: BS EN 933- 1: 2012

Sample number	1681
Ticket No	
Sampled by	Lee
Date Sampled	30/04/2019
Sample location	toast rack
Weather Conditions	

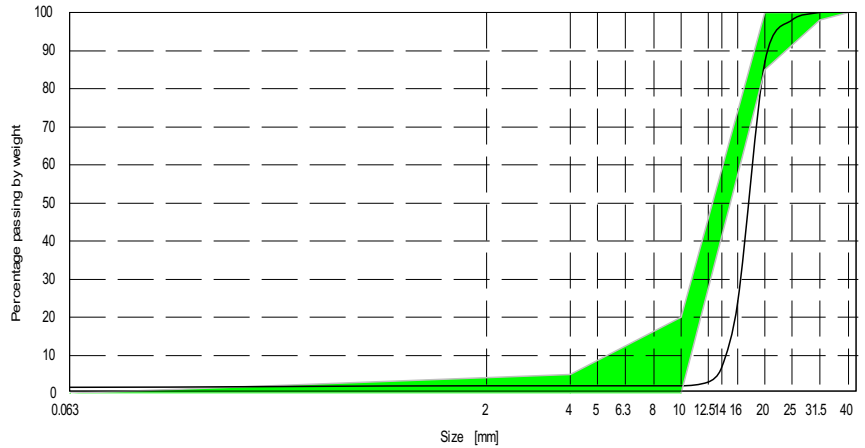

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
40	100	100	Yes	-	-
31.5	100	98 - 100	Yes	-	-
25	98	-	-	-	-
20	87	85 - 100	Yes	-	-
16	24	-	-	-	-
14	7	-	-	-	-
12.5	3	-	-	-	-
10	2	0 - 20	Yes	-	-
8	2	-	-	-	-
6.3	2	-	-	-	-
5	2	-	-	-	-
4	2	0 - 5	Yes	-	-
2	2	-	-	-	-
0.063	1.6	-	-	-	-
Moisture content (%)	2.9				
Uniformity Coefficient	1				

Sampled By: Lee

Tested By: Mercer

Date Tested: 08/05/2019