



David P Hynd  
 Technical Services Department  
 Clatchard laboratory  
 Clatchard Quarry  
 Cupar Road, Newburgh  
 Fife, KY14 6JJ  
 01337 840461

PSD Single Sized Products

**GRADATION ANALYSIS TEST REPORT**  
**for Product: 1200/ 10/20mm Coarse Aggregate**

Supplier/ source: DRY 572 Craigenlow  
 Material type Drystone aggregate Test method Wash grading to BS EN 933-1 2012

**SAMPLE INFORMATION**

Sampled/ tested  
 Thu 14 February 2019/ 19 02 19  
 at 1520 hrs

**Sample number** TOM\_06210\_A  
 Customer Breedon Full Destination STOCK  
 Ticket <> Truck Reg - SampCert <> Chainage 129084  
 Sampled by<>Operator W.HEATHERILL Weather Conditions Cloudy Dry Calm Cool  
 Retest Samp Nos Data - Logged by W Heatherill


**SAMPLE ANALYSIS**

Sieve size	Percent passing	Specification limits	Complies ?
40mm	100	100 - 100	yes
31.5mm	100	98 - 100	yes
25mm	100	-	-
20mm	95	85 - 99	yes
16mm	49	-	-
14mm	30	-	-
12.5mm	13	-	-
10mm	3	0 - 20	yes
8mm	1	-	-
6.3mm	1	-	-
5mm	1	-	-
4mm	1	0 - 5	yes
2.8mm	1	-	-
2mm	1	-	-
1mm	0	-	-
500µm	0	-	-
63µm	0	-	-
Moisture content %	0.5	not specified	-
Flakiness index	11	<=25	yes

Parameters are evaluated to the accuracy of spec. limits

**REMARKS**

Compliance status ok  
 Category A of A-C excludes secondary parameters

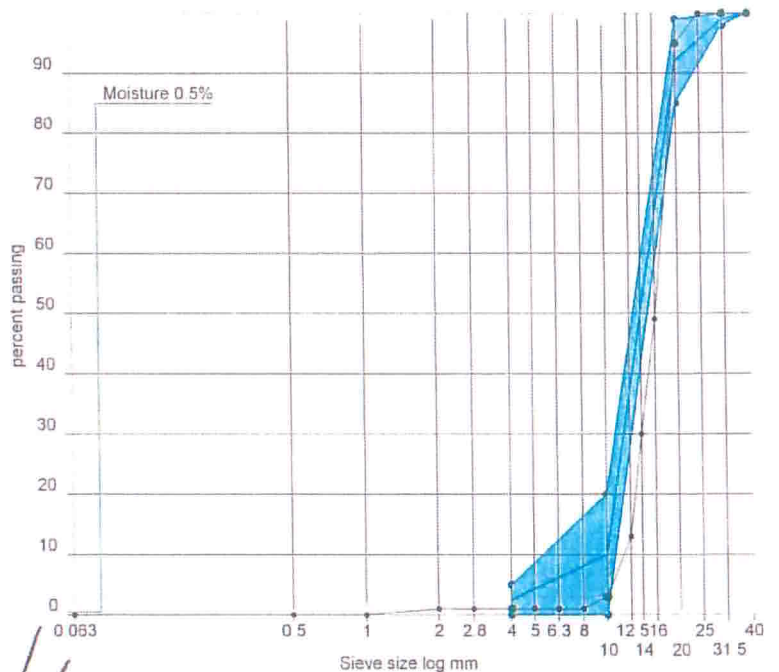

Signed [Signature] Technical Supervisor

Print date 07 May 2019