



David P Hynd
 Technical Services Department
 Clatchard laboratory
 Clatchard Quarry
 Cupar Road, Newburgh
 Fife, KY14 6JJ
 01337 840461

PSD Single Sized Products

GRADATION ANALYSIS TEST REPORT
for Product: 1200/ 10/20 Coarse Aggregate

Supplier/ source: DRY 406 Banavie
 Material type PD6682-2 Table 3 Gc85/20 Test method Dry grading to BS EN 933-1:2012

SAMPLE INFORMATION

Sampled/ tested
 Tue 11 September 2018/ 15-09-18
 at 1303 hrs

Sample number BEN_04893_B
 Customer Breedon Full Destination Stock
 Ticket <> Truck Reg - SampCert <> Chainage -
 Sampled by<>Operator J Buchanan Weather Conditions
 Retest Samp Nos Data - Logged by J Buchanan


SAMPLE ANALYSIS

Sieve size	Percent passing	Specification limits	Complies ?
40mm	100	100 - 100	yes
31.5mm	100	98 - 100	yes
25mm	100	-	-
20mm	99	85 - 99	yes
16mm	67	-	-
14mm	53	-	-
12.5mm	26	-	-
10mm	5	0 - 20	yes
8mm	2	-	-
6.3mm	2	-	-
5mm	1	-	-
4mm	1	0 - 5	yes
500µm	1	-	-
63µm	1	-	-
Moisture content %	1.5	not specified	-
Flakiness index	6	<=35	yes

Parameters are evaluated to the accuracy of spec. limits

REMARKS

Compliance status ok
 Category A of A-C excludes secondary parameters

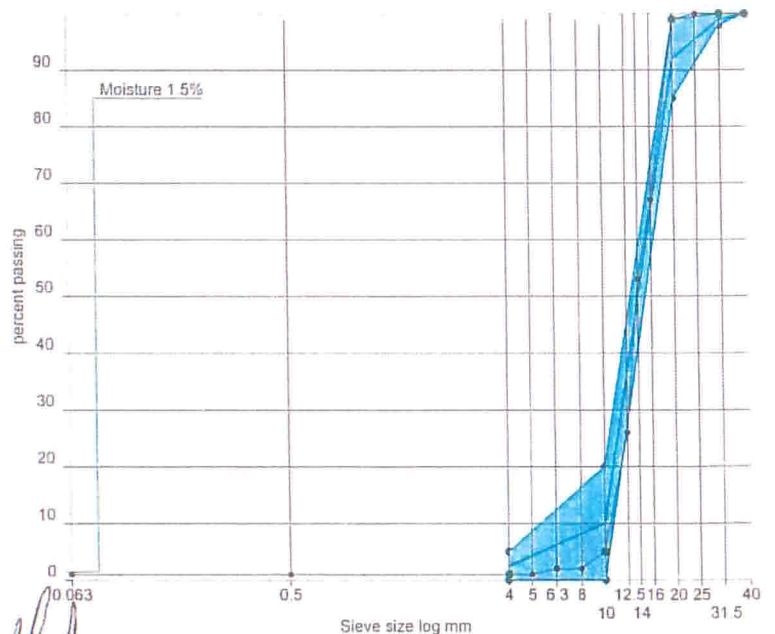

Signed *[Signature]* Technical Supervisor

Print date 07 May 2019