



David P Hynd  
 Technical Services Department  
 Clatchard laboratory  
 Clatchard Quarry  
 Cupar Road, Newburgh  
 Fife, KY14 6JJ  
 01337 840461

PSD Single Sized Products

**GRADATION ANALYSIS TEST REPORT**  
**for Product: 1200/ 10/20 Coarse Aggregate**  
 Supplier/ source: DRY 509 Shierglas

Material type: PD6682-2 Table 3 Gc85/20 Test method: Wash grading to BS EN 933-1:2012

**SAMPLE INFORMATION**

Sampled/ tested  
 Tue 12 February 2019/ 12 02 19  
 at 1105 hrs

**Sample number** CLA\_20794\_F  
 Customer Breedon Production Full Destination Stock - Shierglas  
 Ticket <> Truck Reg - SampCert <> Chainage 130169<>  
 Sampled by<>Operator C Heriot Weather Conditions Mild Dry Cloudy Still  
 Retest Samp Nos Data - Logged by C Heriot


**SAMPLE ANALYSIS**

Sieve size	Percent passing	Specification limits	Complies ?
40mm	100	100 - 100	yes
31.5mm	100	98 - 100	yes
25mm	100	-	-
20mm	98	85 - 99	yes
16mm	56	-	-
14mm	28	-	-
12.5mm	9	-	-
10mm	2	0 - 20	yes
8mm	1	-	-
6.3mm	1	-	-
5mm	1	-	-
4mm	1	0 - 5	yes
500µm	1	-	-
63µm	1	-	-
Moisture content %	0.5	not specified	-
Flakiness index	14	<=35	yes

Parameters are evaluated to the accuracy of spec limits

**REMARKS**

Compliance status ok  
 Category A of A-C excludes secondary parameters

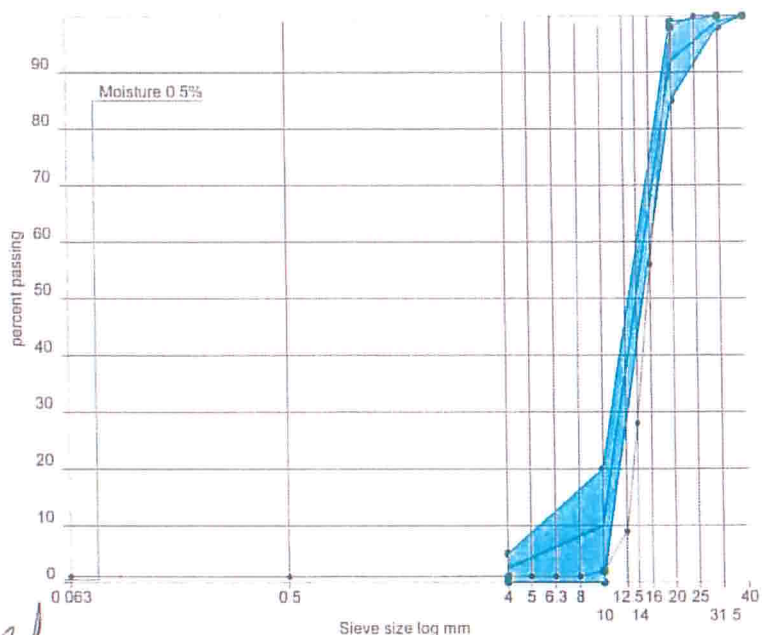

Signed *[Signature]* Technical Supervisor

Print date 07 May 2019