


GRADATION ANALYSIS TEST REPORT

Product: 10/20mm Coarse Agg
 Material Code: A00HS20SS005
 Supplied by:
 Customer:
 Site Address:
 Material type: BS EN 13043 Table 3 / .
 Sampled to: BS EN 932 - 1:1997
 Prepared to: BS EN 933-2 :1999
 Test method: BS EN 933-1 :2012



BTL Inverness Laboratory
 23A Longman Drive, Inverness
 IV1 1SU -

Sample number	7048
Ticket No	
Sampled by	S. Witts
Date Sampled	11/01/2024
Sample location	Stockpile
Weather Conditions	
Remarks	

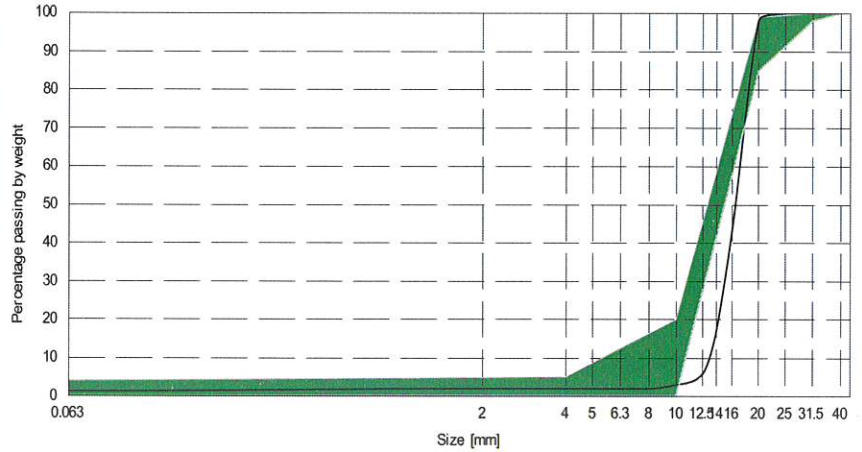

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
40	100	100	Yes	-	-
31.5	100	98 - 100	Yes	-	-
25	100	-	-	-	-
20	98	85 - 99	Yes	-	-
16	43	-	-	-	-
14	17	-	-	-	-
12.5	6	-	-	-	-
10	3	0 - 20	Yes	-	-
8	2	-	-	-	-
6.3	2	-	-	-	-
5	2	-	-	-	-
4	2	0 - 5	Yes	-	-
2	2	-	-	-	-
0.063	1.2	0 - 4.0	Yes	-	-
Moisture content (%)	1.5				
Uniformity Coefficient	1				

Sampled By:

S. Witts

Tested By:

Date Tested:

19/01/2024