## **GRADATION ANALYSIS TEST REPORT** for Product: CA37/ 10-20mm AGGREGATE

Supplier/ source:

Material type: BS EN 12620 Test method: Wash grading to Bs EN 933-1: 2012

## SAMPLE INFORMATION

Sampled/ tested Wed 17 January 2024/ 18-01-24 at 0957 hrs

Sample number BSA12453LJ

Location Source

**Current Production** 

Sampled By

J Parnell

Sampling notes

Weather conditions dry/cold Aggregate type


Remarks 1

LA Value

SAMPLE ANALYSIS

Sieve size	Percent passing	Specification limits	Complies?				
31.5mm 20mm 10mm 4mm 0.063mm	100 97 12 2	100 - 100 85 - 100 0 - 20 0 - 5 0 - 4	yes yes yes yes				
				Moisture content %	1.3	not specified	
				Flakiness index	2	<=35	yes

Parameters are evaluated to the accuracy of spec. limits

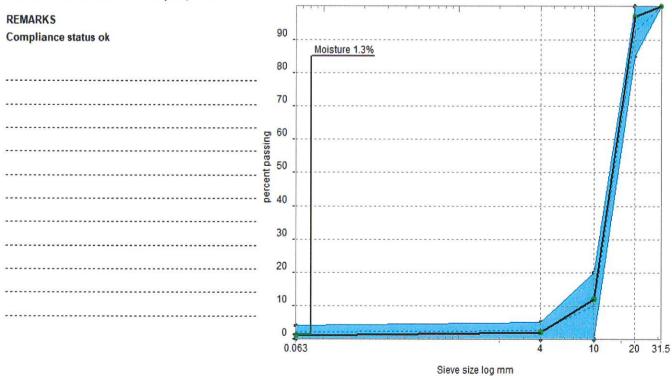

Signed

Technical Manager

Date /2024