## **GRADATION ANALYSIS TEST REPORT**

Product:

10/20mm Coarse Agg

Material Code:

A00HS20SS005

Supplied by: Customer:

Site Address:

Material type:

BS EN 13043 Table 3 / .

Sampled to:

BS EN 932 - 1:1997

Prepared to:

BS EN 933-2:1999

Test method:

BS EN 933-1 :2012

UKAS



BTL Clatchard Laboratory Newburgh Fife KY14 6JJ -

Sample number

Ticket No


Sampled by


Date Sampled

Sample location

Weather Conditions

Remarks



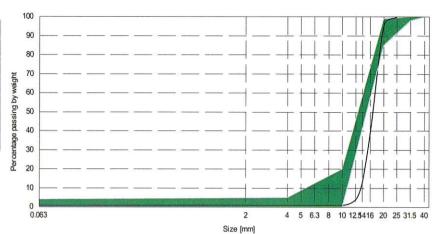

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
40	100	100	Yes		•
31.5	100	98 - 100	Yes	r <del>u</del>	-
25	100	-			-
20	95	85 - 99	Yes		-
16	39	•		-	-
14	13		-	1.	-
12.5	4				
10	1	0 - 20	Yes	a. <del></del>	-
8	1	*		:¥	-
6.3	1	-		-	
5	1		7	:×	•
4	1	0 - 5	Yes		-
2	1	-		1.	-
0.063	0.7	0 - 4.0	Yes		
Moisture content (%)	0.2				
Uniformity Coefficient	1				
Flakiness Index	7	0 - 30			