


GRADATION ANALYSIS TEST REPORT

Product: 6.3/14mm
 Material Code: 614
 Supplied by: Breedon Quarry
 Customer:
 Site Address:
 Material type: 13043 12620 / Limestone



Sampled to: BS EN 932- 1: 1997
 Prepared to: BS EN 932- 2: 1999
 Test method: BS EN 933- 1: 2012

Sample number	1133
Ticket No	
Sampled by	Healey
Date Sampled	01/04/2019
Sample location	Stockpile
Weather Conditions	

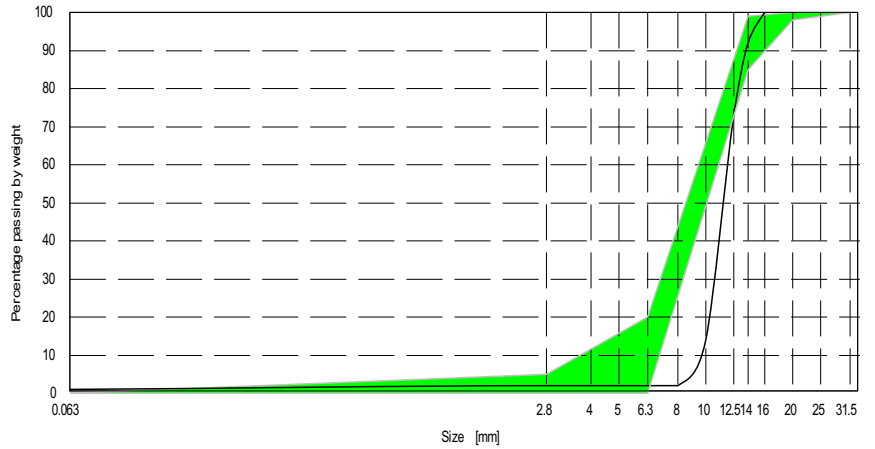

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
31.5	100	100 - 100	Yes	-	-
25	100	-	-	-	-
20	100	98 - 100	Yes	-	-
16	100	-	-	-	-
14	92	85 - 99	Yes	-	-
12.5	73	-	-	-	-
10	14	-	-	-	-
8	2	-	-	-	-
6.3	2	0 - 20	Yes	-	-
5	2	-	-	-	-
4	2	-	-	-	-
2.8	2	0 - 5	Yes	-	-
0.063	0.9	-	-	-	-
Moisture content (%)	0.2				
Uniformity Coefficient	1				

Sampled By: Healey

Tested By: Smith

Date Tested: 01/04/2019