


GRADATION ANALYSIS TEST REPORT

Product: 6.3/14mm
 Material Code: 614
 Supplied by: Holme Hall Quarry
 Customer:
 Site Address:
 Material type: BS EN 12620 / Limestone



Sampled to: BS EN 932- 1: 1997
 Prepared to: BS EN 932- 2: 1999
 Test method: BS EN 933- 1: 2012

Sample number	1490
Ticket No	
Sampled by	Lee
Date Sampled	15/04/2019
Sample location	Toast rack
Weather Conditions	

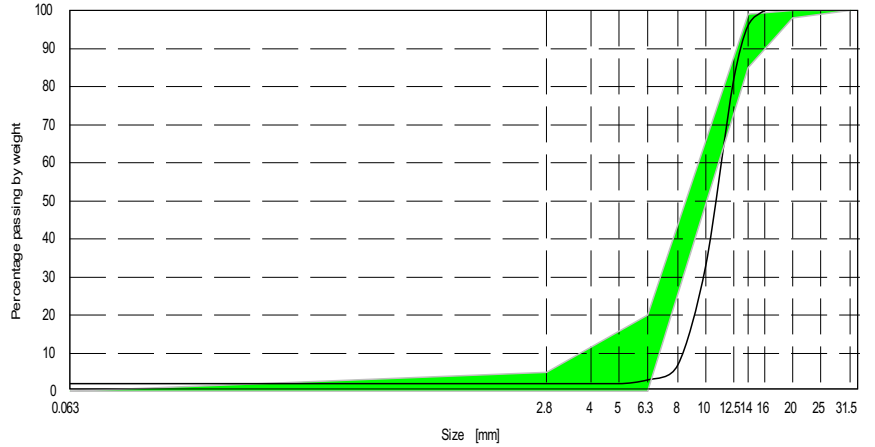

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
31.5	100	100 - 100	Yes	-	-
25	100	-	-	-	-
20	100	98 - 100	Yes	-	-
16	100	-	-	-	-
14	96	85 - 99	Yes	-	-
12.5	82	-	-	-	-
10	33	-	-	-	-
8	7	-	-	-	-
6.3	3	0 - 20	Yes	-	-
5	2	-	-	-	-
4	2	-	-	-	-
2.8	2	0 - 5	Yes	-	-
0.063	1.9	-	-	-	-
Moisture content (%)	3.5				
Uniformity Coefficient	1				

Sampled By: Lee

Tested By: Mercer

Date Tested: 18/04/2019