


GRADATION ANALYSIS TEST REPORT

Product: Type 1 GSB
 Material Code: 803
 Supplied by: Breedon Quarry
 Customer:
 Site Address:
 Material type: SHW Series 800 / Limestone



Sampled to: BS EN 932- 1: 1997
 Prepared to: BS EN 932- 2: 1999
 Test method: BS EN 933- 1: 2012

Sample number	1501
Ticket No	
Sampled by	Woodward
Date Sampled	23/04/2019
Sample location	Stockpile
Weather Conditions	

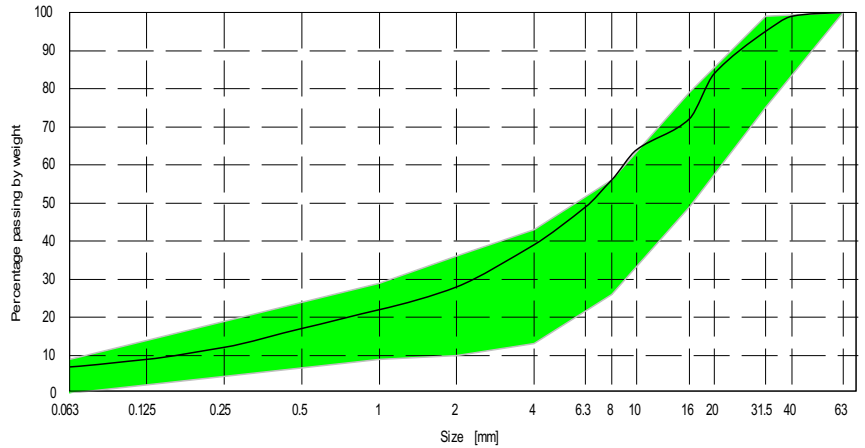

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
125		-	-	-	-
80		-	-	-	-
63	100	100 - 100	Yes	-	-
40	99	-	-	-	-
31.5	95	75 - 99	Yes	-	-
20	84	-	-	-	-
16	72	49 - 79	Yes	-	-
10	64	-	-	-	-
8	56	26 - 56	Yes	-	-
6.3	49	-	-	-	-
4	39	13 - 43	Yes	-	-
2	28	10 - 36	Yes	-	-
1	22	9 - 29	Yes	-	-
0.5	17	-	-	-	-
0.25	12	-	-	-	-
0.125	9	-	-	-	-
0.063	7.0	0 - 9.0	Yes	-	-
Moisture content (%)	1.9				
Uniformity Coefficient	54				

Sampled By: Woodward

Tested By: Healey

Date Tested: 23/04/2019