GRADATION ANALYSIS TEST REPORT
for Product: CA37/ 10-20mm AGGREGATE

Supplier/ source:

Material type: BS EN 12620 Test method: Wash grading to BS EN 933-1: 2012

SAMPLE INFORMATION

Sampled/ tested
Mon 29 June 2020/ 30-06-20
at 0841 hrs

Sample number BSA09304LJ

Location	Current Production	Sampled By	J Parnell
Source	-	Weather conditions	Dry / Overcast
Sampling notes	-	Aggregate type	-
Remarks 1		LA Value	-

SAMPLE ANALYSIS

Sieve size	Percent passing	Specification limits	Complies ?
31.5mm	100	100 - 100	yes
20mm	91	85 - 100	yes
16mm	51	-	-
10mm	9	0 - 20	yes
4mm	3	0 - 5	yes
2mm	3	-	-
0.063mm	1	0 - 4	yes
Moisture content %	1.2	not specified	-
Flakiness index	3	<=35	yes

Parameters are evaluated to the accuracy of spec. limits

REMARKS

Compliance status ok

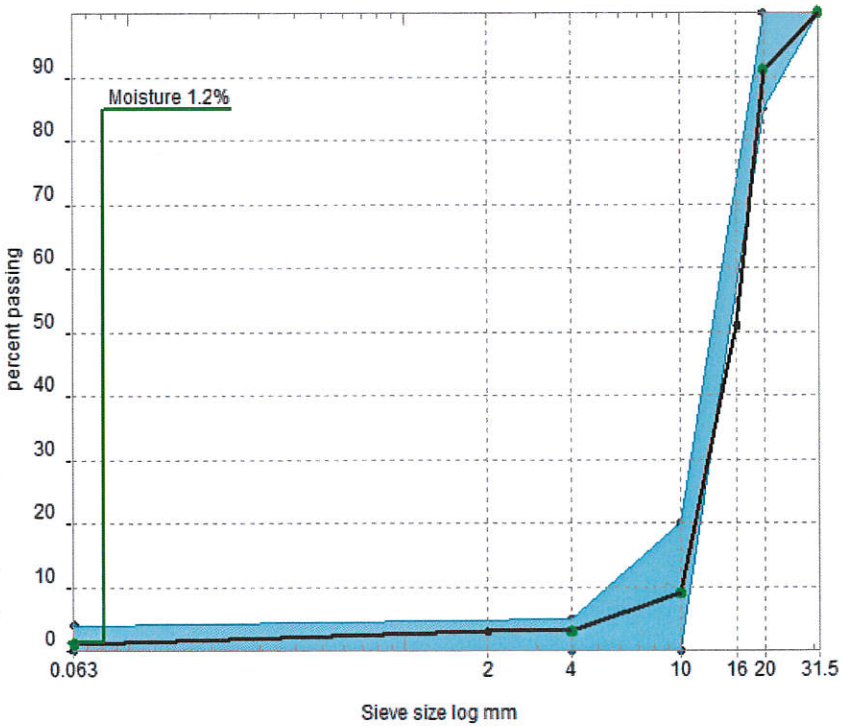

Signed _____Technical Manager

Print date 01 Jul 2020

Gradlab GDS v7.17 © Hugh Lerwill www.gradlab.com. Licence#: AA01/352 for Brookland Sand & Aggregates, Site/user name: Carthew.