


**GRADATION ANALYSIS TEST REPORT**

Product: **Wayfarer**  
 Material Code: **BR04**  
 Supplied by: **Breedon Quarry**  
 Customer:  
 Site Address:  
 Material type: **Proprietary / Limestone**



Sampled to: **BS EN 932- 1: 1997**  
 Prepared to: **BS EN 932- 2: 1999**  
 Test method: **BS EN 933- 1: 2012**

Sample number	1584
Ticket No	
Sampled by	Woodward
Date Sampled	29/04/2019
Sample location	Stockpile
Weather Conditions	

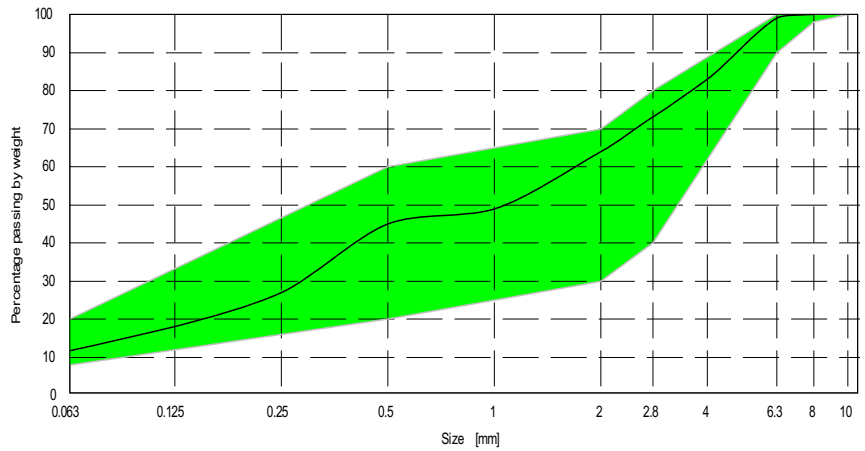

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)	Control limits	Complies (Ctrl)
14		-	-	-	-
10	100	100 - 100	Yes	-	-
8	100	98 - 100	Yes	-	-
6.3	99	90 - 100	Yes	-	-
4	83	-	-	-	-
2.8	73	40 - 80	Yes	-	-
2	64	30 - 70	Yes	-	-
1	49	-	-	-	-
0.5	45	20 - 60	Yes	-	-
0.25	27	-	-	-	-
0.125	18	-	-	-	-
0.063	11.7	8.0 - 20.0	Yes	-	-
Moisture content (%)	5.6				

Sampled By: **Woodward**

Tested By: **Smith**

Date Tested: **01/05/2019**