

Welsh Slate & Aggregates
Penrhyn Quarry
Bethesda
Bangor
Gwynedd
LL57 4YG
Contract: Penrhyn Quarry

Date: 07 October 2024
Test Report Ref: TR 1070089

Page 1 of 1

LABORATORY TEST REPORT


TEST REQUIREMENTS:

To determine the Particle Size Distribution (PSD) of an aggregate sample- washing and sieving method to **BS EN 933-1: 2012**.

SAMPLE DETAILS:

Certificate of sampling received:	Yes	Name of Source:	Penrhyn Quarry
Laboratory Ref. No:	S125696 / 330224	Method of Sampling:	Unknown
Client Ref. No:	330224 - 2/14mm	Sampled By:	Client (Test results apply to sample as received)
Date and Time of Sampling:	27/09/2024	Tested By:	LT
Date of Receipt at Lab:	27/09/2024		
Date of Start of Test:	30/09/2024		
Sampling Location:	Production Stockpile		
Material Description:	2/14mm		
Target Specification:	SHW Volume 1 Clause 503 Table 5/3 - BS EN 13242 Coarse aggregate for Pipe bedding, haunching and surrounding material - PD 6682-6: 2009 - Table 3		

RESULTS: Were any unrepresentative lumps present? No

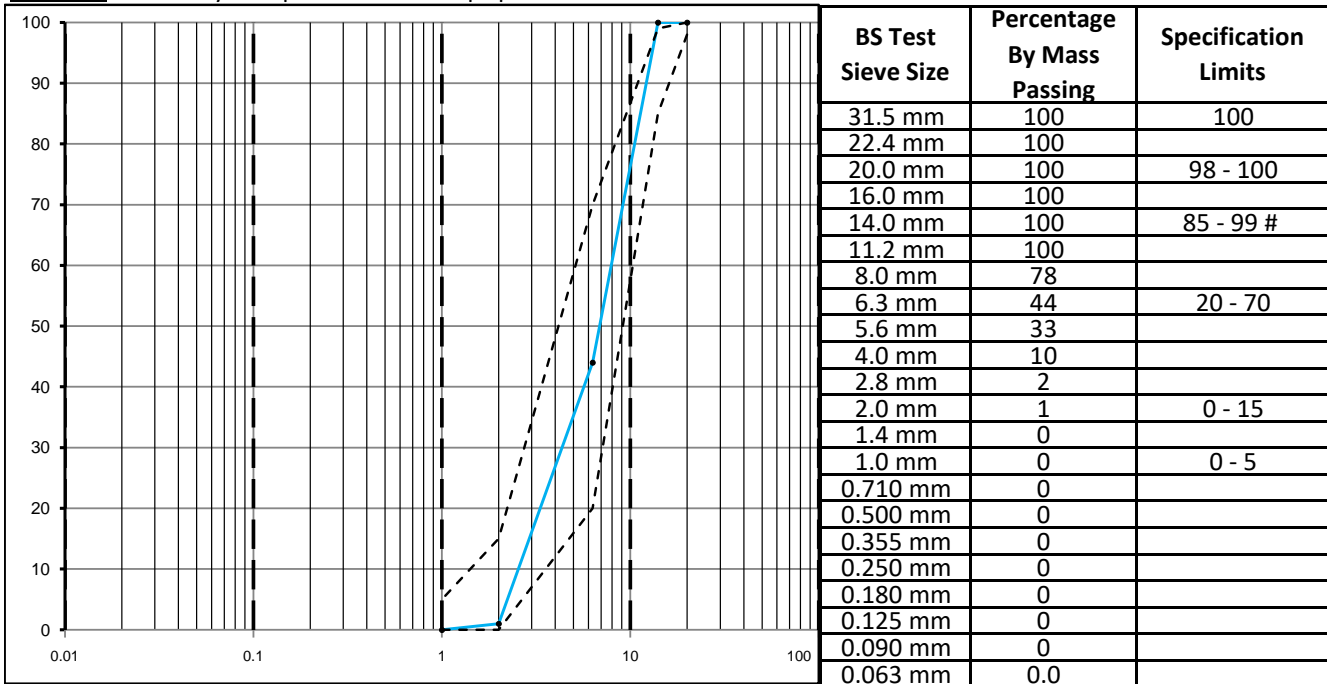

This test report shall not be reproduced, except in full, without the written approval of Celtest Company Limited.

These results relate only to the items tested.

Comments:

Complies with specification requirements for 2/14mm Crushed Rock Aggregate - Grading limits
The inclusion of 99% in lieu of 100% is to ensure consistency and to prevent smaller size aggregate being classified as D sized aggregate. However, the percentage passing D may be greater than 99% by mass but in such cases the producer is required to document and declare the typical grading.

Report checked and approved by:



Izabella Kantor
CS Team